




### CLASS "A" BEDDING

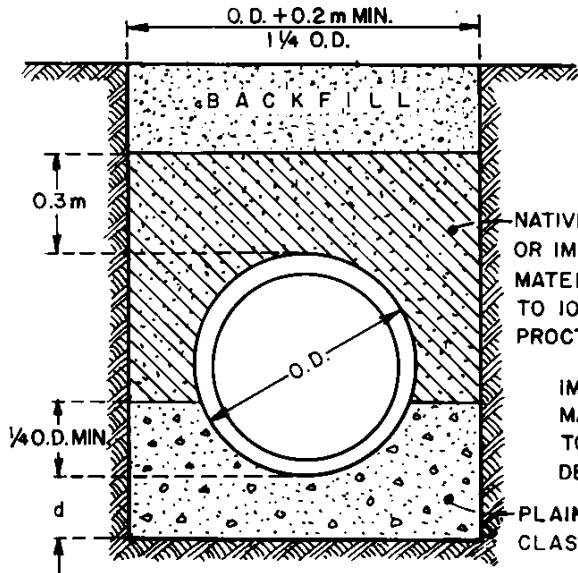


### CLASS "B" BEDDING

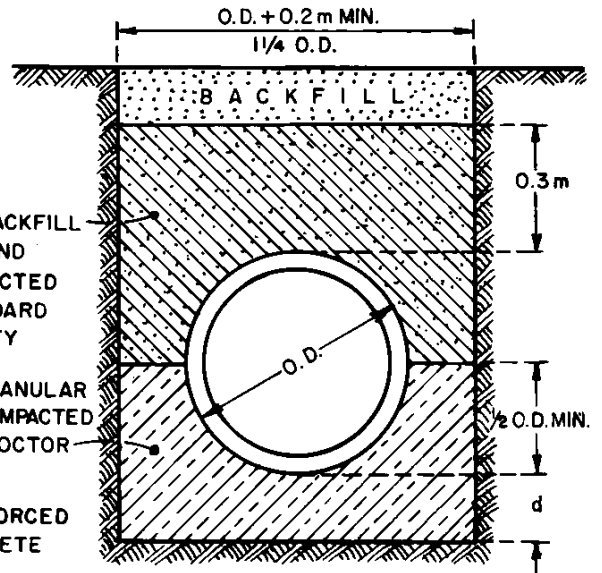

### CLASS "C" BEDDING

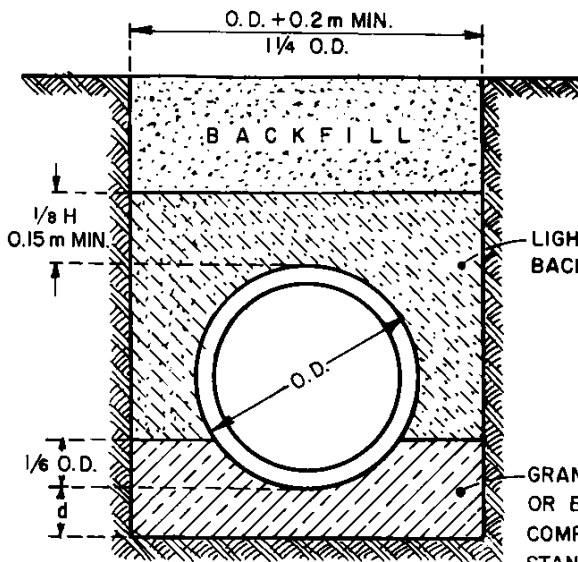

### CLASS "D" BEDDING

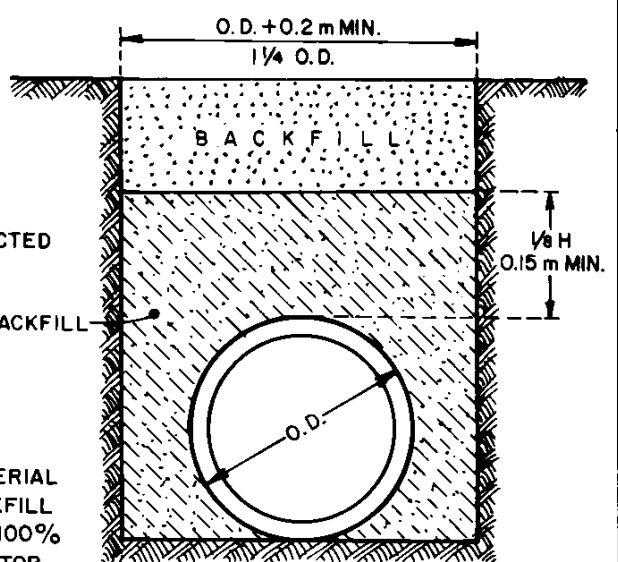

**NOTE:** FOR ROCK OR OTHER INCOMPRESSIBLE MATERIALS, THE TRENCH SHOULD BE OVEREXCAVATED A MINIMUM OF 0.15 m AND REFILLED WITH GRANULAR MATERIALS.

I. D.	d (MIN.)
700 mm and SMALLER	80mm
800 mm to 1600 mm	120mm
1800 mm and LARGER	160mm

#### LEGEND:

- O.D. = OUTSIDE PIPE DIAMETER
- H = BACKFILL COVER ABOVE TOP OF PIPE
- I. D. = INSIDE PIPE DIAMETER
- d = DEPTH OF BEDDING MATERIAL BELOW PIPE

**Alberta**

TRANSPORTATION  
Engineering Division

DWG. No

CB - 6  
2.10. M 18

Date

Original

May, 1981

Revised

Revised

## TYPES OF TRENCH BEDDING AND BACKFILL FOR STORM SEWER