


- LEGEND:**
- \$ SINGLE POLE SWITCH
 - ⊙ 120V LED SURFACE MOUNTED LIGHT (7W)
 - ⊙ 120V LED WALL MOUNTED LIGHT (7W)
DAMP PROOF COVER
 - ⊙R 120V LED RECESSED FLOOD LIGHT (4W)
 - ⊙ WP GFI 110V DUPLEX RECEPTICLE
WEATHERPROOF, GROUND FAULT INTERRUPT
 - ▶ MOTION SENSOR
 - ⊙ T THERMOSTAT
 - ⊙ PHC PHOTO CELL
 - BRK PANEL BREAKER PANEL - 125A 18 CIRCUIT
60A MAIN, 1-30A 2 POLE BREAKER,
8-15A 1 POLE
 - M UTILITY METER AS NECESSARY
 - UPS UNINTERRUPTED POWER SUPPLY
500W 4 HOUR. (INSTALL TO SUPPLY
POWER TO LIGHTS ONLY)
 - TWH ELECTRIC TANKLESS WATER HEATER
6000W 208/240V MINI BOILER
 - P CIRCULATION PUMP
1/25 HP 120V
 - F INLINE FAN
50 CFM @ 1" WATER, PVC SHELL
 - RHEOSTAT
TO CONTROL INLINE FAN
 - RADIATOR WALL MOUNTED RADIATOR
700 x 900 SINGLE PASS

TOILET ELECTRICAL AND MECHANICAL PLAN
N.T.S.

ROOF OUTLINE

- NOTES:**
- ALL DIMENSIONS SHOWN IN MILLIMETRES
 - WORK THESE DRAWINGS TOGETHER
CB6-4.6M1 TO 15 AND 17
 - SUPPLY 1 SPARE BULB OF EACH STYLE
TO EACH BUILDING

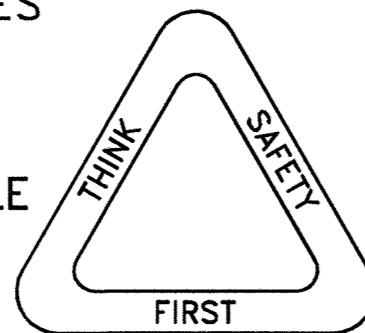

CAD FILE No. Washroom-ElecRoadside5

△			
△			
△	2013-01-18	REVISED SHEET SURROUND	AN
△	2012-02-07	REDRAWN	AN
REV	DATE	REVISIONS	BY
DESIGNER	AN	CHECKER	

RECOMMENDED
DIRECTOR HIGHWAY OPERATIONS

[Signature]

APPROVED
EXECUTIVE DIRECTOR
TECHNICAL STANDARDS BRANCH

[Signature]

Alberta Transportation

**DOUBLE TOILET
GRID-POWER ELECTRICAL AND
MECHANICAL LAYOUT PLAN**

DEPARTMENT BAR CODE	DATE	SHEET	DRAWING
	2012-02-07	16 OF 21	CB6-4.6M15